

Boral Construction Materials Materials Technical Services

Unit 4, 3-5 Gibbon Road Baulkham Hills NSW 2153 Australia

PO Box 400, Winston Hills NSW 2153

T +61 (02) 9624 9900

TEST REPORT - CURING COMPOUND

boral.com.au

CLIENT:

EVENRANGE PTY LTD

FILE NO:

258/23

12 Frankston Gardens Drive, Carrum Downs, VIC 3201

REQUEST NO: 108594

LAB. SAMPLE NO: 292696

JOB DESCRIPTION: CURING COMPOUND EVALUATION

TEST METHOD:

AS 3799 - 1998 - Liquid Membrane-forming Curing Compounds for Concrete

DISTRIBUTOR: PARCHEM

SAMPLE IDENTIFICATION: CONCURE B90

SAMPLE DESCRIPTION: Bitumen Hydrocarbon based curing compound

CLASSIFICATION: CLASS Z, TYPE 1

SAMPLE SOURCE: VIC

DATE SAMPLED: 16/10/2023

DATE RECEIVED: 17/10/2023

METHOD OF APPLICATION: by spraying at standard application rate of 5 m²/L

TEST DESILITS.

Standard property, Test (Method)	Specification	Result	Date Tested
Water retention efficiency AS 3799.3.1.2 (Appendix B)	Min. 90%	92%	11-14/11/2023
Non - volatile content* AS 3799.3.1.8 (Method AS 1580.301.1)	N/A	53.51%	24/10/2023
Density* AS 3799.3.1.9 (Method AS/NZS 1580.202.1)	N/A	0.997 kg/L	08/11/2023
Viscosity* AS 3799.3.1.5 (Method AS/NZS 1580.214.5)	Min. 0.05 Pa.s (emulsions) Min. 0.02 Pa.s (solutions)	0.05 Pa.s	08/11/2023
Drying Time* AS 3799.3.1.4 (Appendix C)	Max. 4 Hrs	4 Hrs	11/11/2023
Infrared absorption spectrum* AS 3799.3.2 (Boral In-house Method)	N/A	Attached	17/11/2023
Stability of emulsion* RMS T862	Max. 4%	0.20%	16/11/2023
Residue 150 μm* AS 3799.3.1.6 (Method AS/NZS 2341.26)	Max. 0.2%	0.14%	30/10/2023

Notes:


- Sample supplied by the client and tested as received.
- * Test method is not in the current scope of NATA accreditation for the Boral MTS Laboratory.

Kane Latham, Mat File, File

Julius Alvaro Approved Signal CEM108594 JA 2 Date _ Serial No.





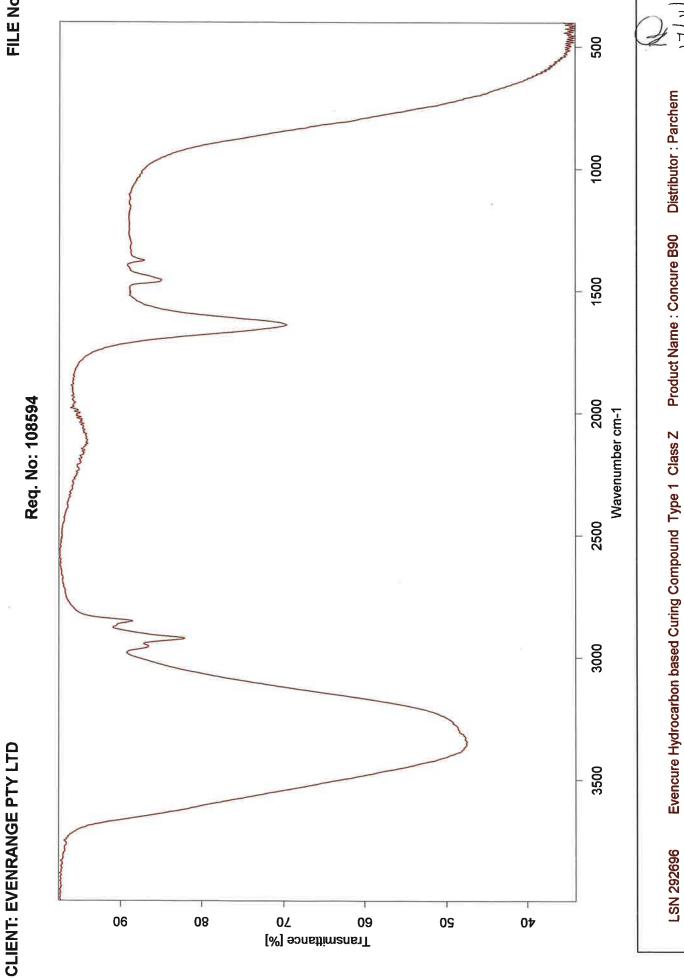

Page 1/1